CITY OF SACRAMENTO

1231 I Street, Sacramento, CA 95814

Permit No: 0001233
Insp Area: 4

Site Address: 2500 NORTHGATE BL SAC
Parcel No: 262-0252-002

Sub-Type: ACOM
Housing (Y/N): N

CONTRACTOR	***OWNER***	***ARCHITECT***
HERBST ENGINEERING INC 8561 YOUNGER CREEK RD SAC CA 95828	CONOCO INC HOUSTON TX 77252	

Nature of Work: PROVIDE ELECTRICAL FOR CHANGE OUT OF UNDERGRD TANKS AND DISPENSORS

CONSTRUCTION LENDING AGENCY : I hereby affirm under penalty of perjury that there is a construction lending agency for the performance of the work for which this permit is issued (Sec. 3097, Civ. C).

Lender's Name NONE Lender'sAddress _____

LICENSED CONTRACTORS DECLARATION: I hereby affirm under penalty of perjury that I am licensed under provisions of Chapter 9 (commencing with section 7000) of Division 3 of the Business and Professions Code and my license is in full force and effect.

License Class A/B/HAZ License Number 503266 Date 2-9-00 Contractor Signature Mark L

OWNER-BUILDER DECLARATION: I hereby affirm under penalty of perjury that I am exempt from the contractors License Law for the following reason (Sec. 7031.5, Business and Professions Code; any city or county which requires a permit to construct, alter, improve, demolish, or repair any structure, prior to its issuance, also requires the applicant for such permit to file a signed statement that he or she is licensed pursuant to the provisions of the Contractors License Law (Chapter 9 (commencing with Section 7000) of Division 8 of the Business and Professions Code) or that he or she is exempt therefrom and the basis for the alleged exemption. Any violation of Section 7031.5 by any applicant for a permit subjects the applicant to a civil penalty of not more than five hundred dollars ($500.00);

_____ I, as a owner of the property, or my employees with wages as their sole compensation, will do the work, and the structure is not intended or offered for sale (Sec. 7044, Business and Professional Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who does such work himself or herself or through his/her own employees, provided that such improvements are not intended or offered for sale. If, however, the building or improvement is sold within one year of completion, the owner-builder will have the burden of proving that he/she did not build or improve for the purpose of sale.)

_____ I, as owner of the property, am exclusively contracting with licensed contractors to construct the project (Sec. 7044, Business and Professions Code: The Contractors License Law does not apply to an owner of property who builds or improves thereon, and who contracts for such projects with a contractor(s) licensed pursuant to the Contractors License Law).

_____ I am exempt under Sec._____ B & PC for this reason:_____

Date_____ Owner Signature_____

IN ISSUING THIS BUILDING PERMIT, the applicant represents, and the city relies on the representation of the applicant, that the applicant verified all measurements and locations shown on the application or accompanying drawings and that the improvement to be constructed does not violate any law or private agreement relating to permissible or prohibited locations for such improvements. This building permit does not authorize any illegal location of any improvement or the violation of any private agreement relating to location of improvements.

I certify that I have read this application and state that all information is correct. I agree to comply with all city and county ordinances and state laws relating to building construction and herby authorize representative(s) of this city to enter upon the abovementioned property for inspection purposes.

Date 2-9-00 Applicant/Agent Signature Mark L

WORKER'S COMPENSATION DECLARATION: I hereby affirm under penalty of perjury one of the following declarations:

_____ I have and will maintain a certificate of consent to self-insure for workers' compensation as provided for by Section 3700 of the Labor Code, for the performance of work for which the permit is issued.

PAID
CITY OF SACRAMENTO
FEB 9 2000
NEIGHBORHOODS, PLANNING AND DEVELOPMENT SERVICES

__Y__ I have and will maintain workers' compensation insurance, as required by Section 3700 of the Labor Code, for the performance of the work for which this permit is issued. My workers' compensation insurance carrier and policy number are:

Carrier STATE FUND Policy Number [illegible] Exp Date 08/01/2000

_____ (This section need not be completed if the permit is for $100 or less) I certify that in the performance of the work for which this permit is issued, I shall not employ any person in any manner so as to become subject to the workers' compensation laws of California and agree that if I should become subject to the workers' compensation provisions of Section 3700 of the Labor Code, I shall forthwith comply with those provisions.

Date 2-9-00 Applicant Signature Mark L

WARNING: FAILURE TO SECURE WORKER'S COMPENSATION COVERAGE IS UNLAWFUL AND SHALL SUBJECT AN EMPLOYER TO CRIMINAL PENALTIES AND CIVIL FINES UP TO ONE HUNDRED THOUSAND DOLLARS ($100,000) IN ADDITION TO THE COST OF COMPENSATION, DAMAGES AS PROVIDED FOR IN SECTION 3706 OF THE LABOR CODE, INTEREST AND ATTORNEY'S FEE.

THIS PERMIT SHALL EXPIRE BY LIMITATION IF WORK IS NOT COMMENCED WITHIN 180 DAYS.

BEACON STATION
2500 NORTHGATE BLVD
SACRAMENTO. Ca 95833

APPROVED PER 1996
NATIONAL ELECTRICAL CODE
AND CITY OF SACRAMENTO
AMENDMENTS:
I.M. 2.9.00
ELECTRICAL DIVISION

NEC 514

The approval of all
Electrical work is subject to field
inspections

2500 Northgate Blvd 00123 3C

City Copy

ELECTRICAL SCOPE OF WORK

TANK AND DISPENSER INSTALLATION. INSTALL NEW CONDUITS FROM TANKS / DISPENSERS TO NEW GUTTER AT BACK OF BUILDING

NOTES:
- ALL CONDUITS TO HAVE SEALOFF FITTING AT EACH END
- ALL CONDUITS SHALL 3/4" IMC & PVC40 WITH IMC AT THE ENDS OF EACH RUN
- ALL CONDUITS SHALL HAVE 24" COVER TO FINISHED GRADE
- WIRE TO BE GASOLINE & OIL RESISTANT THHN STRANDED
- GROUNDING BUSHINGS SHALL BE INSTALLED ON EACH CONDUIT IN WIREWAY
- EMT CONDUIT WITH EXTERIOR FITTINGS SHALL BE USED FROM WIREWAY TO ELECTRONICS WALL

KEYNOTES:
1. 3/4" C FROM DISPENSER TO WIREWAY (4) - 10 #12 AUG EA
2. 3/4" C FROM DISPENSER INTERCOM TO WIREWAY (4) 2 - 3/4 #14 AUG EA
3. 3/4" C FROM TURBINE TO WIREWAY (3) 3 - #12 AUG EACH
4. 3/4" C FOR MONITORING SYSTEM - LOOPED TO EACH SENSOR AND PIPING SUMP 3 TO WIREWAY - 1 CABLE PER SERVICE
5. NEMA 3R GUTTER / WIREWAY WITH DIVIDER FOR [illegible]
6. 3/4" C FOR LIGHTING POWER TO EXISTING CANOPY LIGHTS 2 6 - #12 AUG EACH

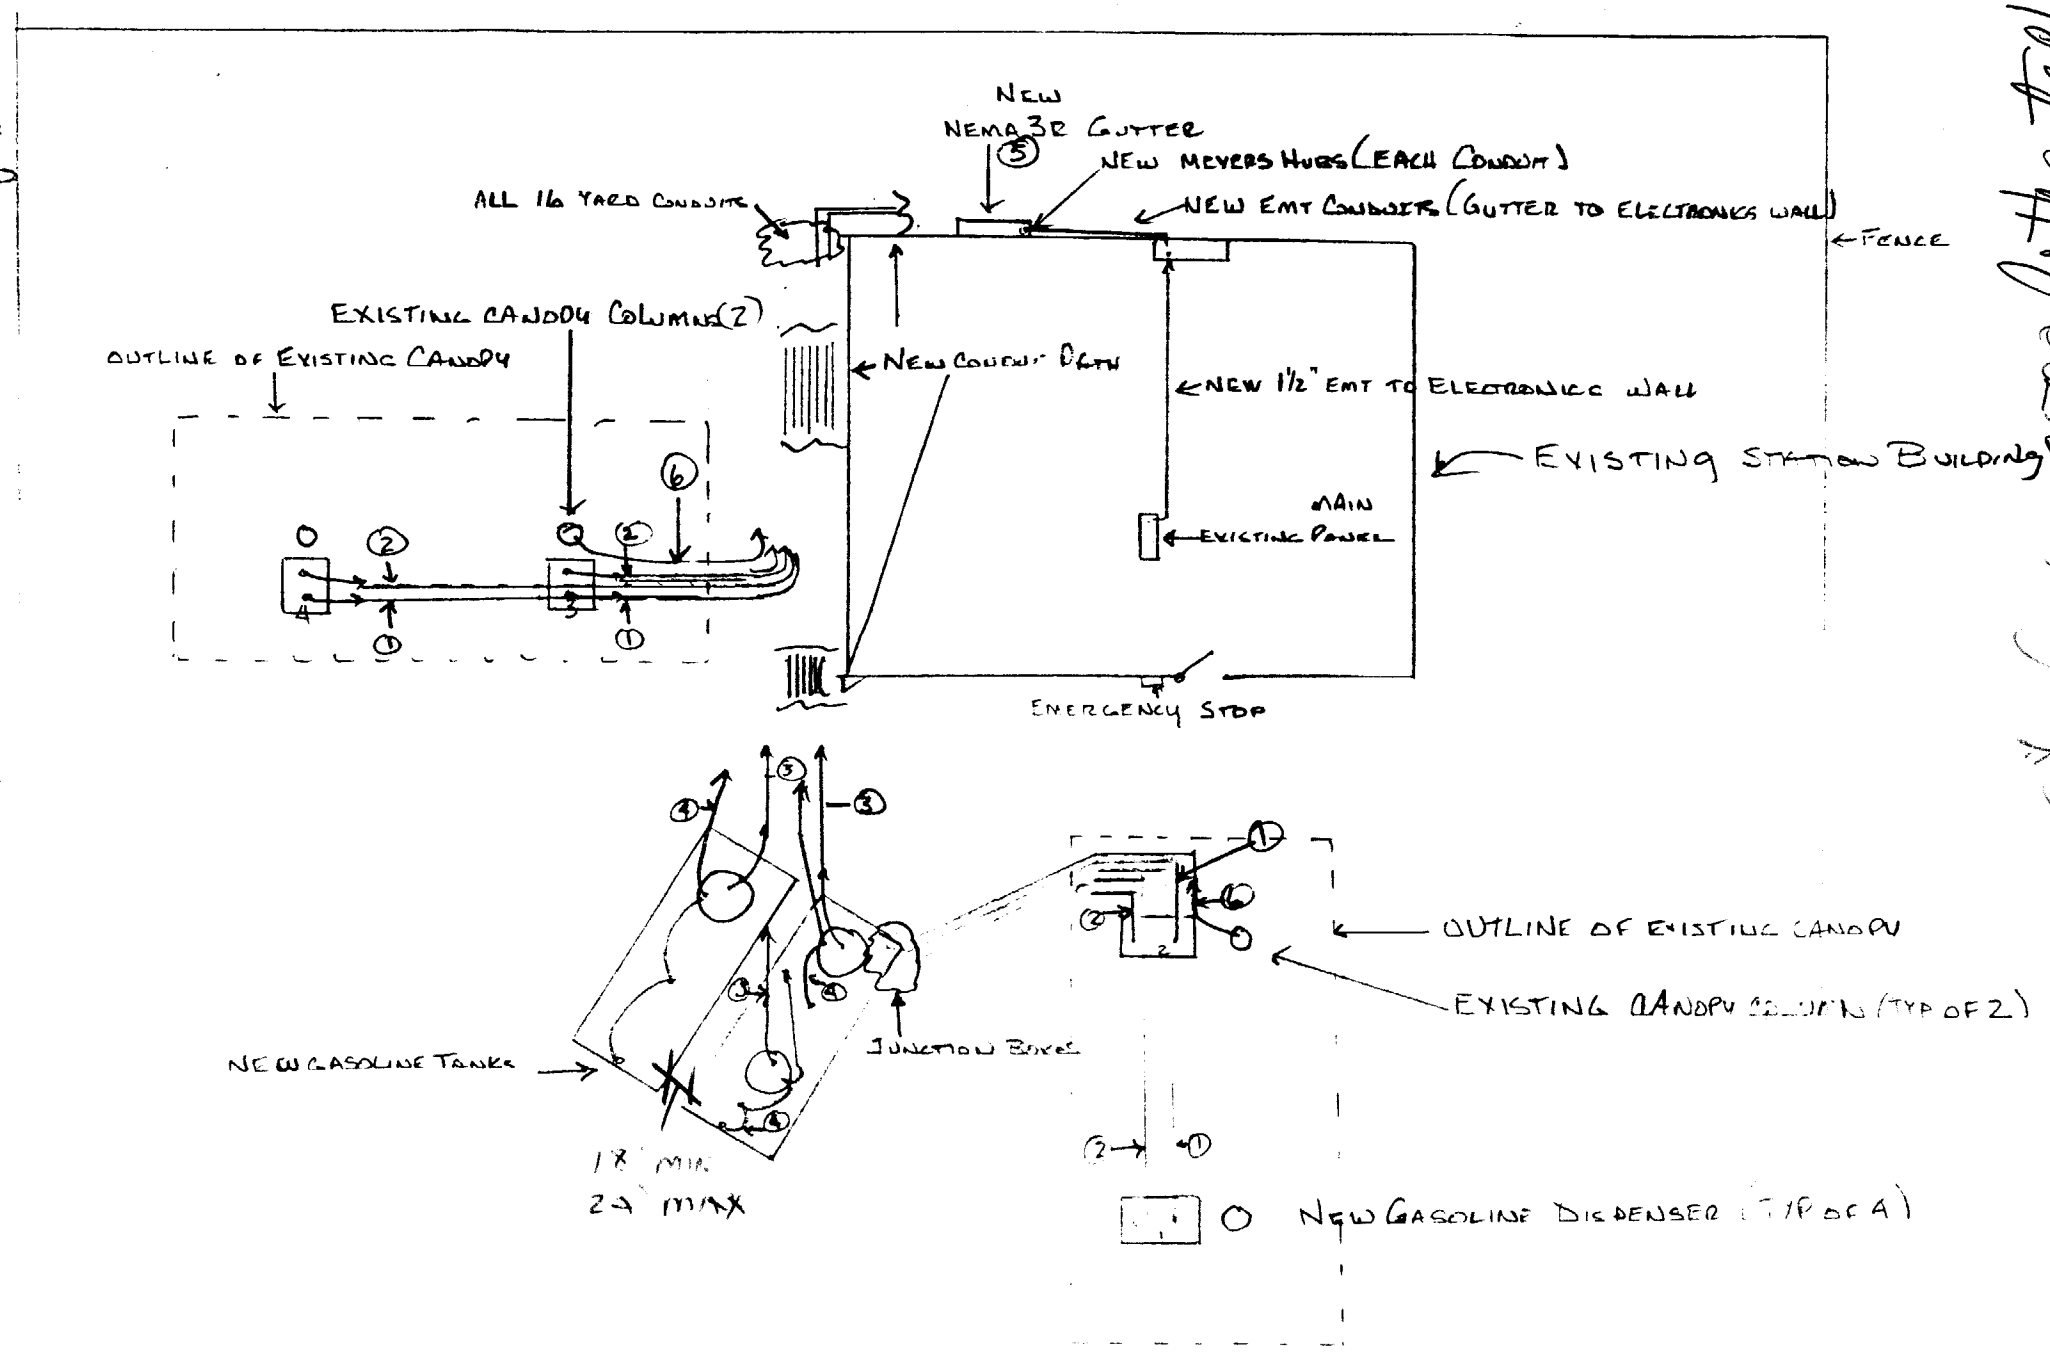

NORTHGATE BLVD

EL CAMINO AVE

1" = 20'

NEMA 3R GUTTER AT BACK OF BUILDING

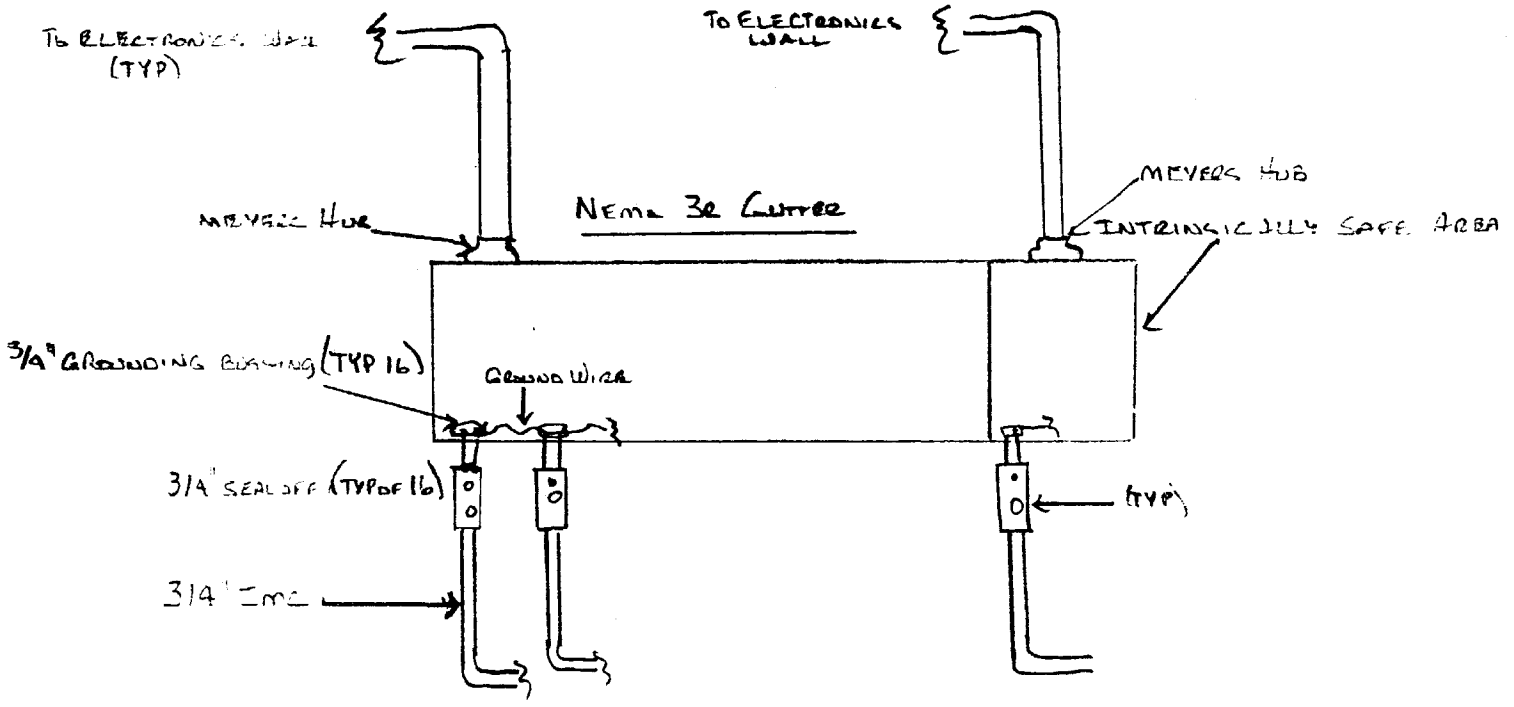

PARTIAL PANEL SCHEDULE

EXISTING 200 AMP SERVICE

200A

1, 3	20A RIG STP	2, 4	20A BUSHING CANOPY LIGHTS
5, 7	20A SUP STP	6, 8	20A EXISTING CANOPY LIGHTS
9, 11	20A DIESEL STP	10	EXISTING
13	20A MONITOR	12	
15	SPARE	14	
17	EMERGENCY STOP	16	
19	SPARE	18	
21	30A - PANEL B	20	
		22	

PANEL B

(DISPENSER PANEL - "A" PHASE ONLY)

1*, 3	20A #1	2, 4	20A #3
5, 7	20A #2	6, 8	20A #4

*ALL DISPENSER BREAKERS ARE SWITCHED NEUTRAL